

Australian Wool Testing Authority Ltd - trading as AWTA Product Testing A.B.N 43 006 014 106 1st Floor, 191 Racecourse Road, Flemington, Victoria 3031 P.O Box 240, North Melbourne, Victoria 3051 Phone (03) 9371 2400

## **TEST REPORT**

| Client : | Basford Brands Pty Ltd<br>16 - 20 Apparel Close | Test Number<br>Issue Date | : | 20-003454<br>16/07/2020 |
|----------|---|---------------------------|---|-------------------------|
|          | Breakwater VIC 3219                             | Print Date                | : | 16/07/2020              |

| Sample Description | Clients Ref : "Juniper"                      |
|--------------------|--|
|                    | Woven blockout textile                       |
|                    | End Use : Drapery                            |
|                    | Nominal Composition : 100% Polyester         |
|                    | Nominal Mass per Unit Area/Density : 350g/m2 |

AS 1530.2-1993


## Methods for Fire Tests on Building Materials, Components and Structures. . .... . . ----- - -

| Part 2: Test for Flammability of Materials |        |       |        |
|--|--------|-------|--------|
| Date Tested                                |        |       |        |
| Flammability Index                         |        | 3     |        |
|  | Length | Width |        |
| Spread Factor                              | 2      | 1     |        |
| Heat Factor                                | 1      | 1     |        |
| Maximum height (d)                         |        |       |        |
| Mean                                       | 3.8    | 3.3   |        |
| Coefficient of Variation                   | 93.4   | 61.8  | %      |
| Heat (a)                                   |        |       |        |
| Mean                                       | 3.9    | 2.1   | °C.min |
| Coefficient of Variation                   | 75.8   | 55.3  | %      |
| Number of Specimens Tested                 | 9      | 9     |        |

Observation

Visible smoke, melting, dripping.

These test results relate only to the behaviour of the test specimens of the material under the particular conditions of the test, and they are not intended to be the sole criterion for assessing the potential fire hazard of the material in use.

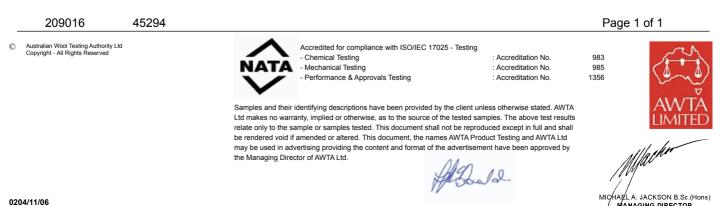

APPROVED SIGNATORY

MANAGING DIRECTOR